

PORT WASHINGTON WATER DISTRICT

38 Sandy Hollow Road, Port Washington, NY 11050 ♦ (516) 767-0171 ♦ (516) 767-1145 -Fax

Application for Supply of Water



Do Not Photocopy

(No photocopies of this form will be accepted)

All information must be complete (please print or type).

Date: _____ Account Number: _____
(Completed by District)

Owner's full Name: _____
(First Name) (Middle Initial) (Last Name)

Address: _____
(Street) (Town/City) (State/Zip)

Home Phone: _____ Work Phone: _____ E-Mail: _____
(Optional)

Address of property to be served (if different from above address):

(Street) (Town/City) (State/Zip)

Section: _____ Block: _____ Lot: _____ Zoning District: _____

Plumber's Name & Contact Person: _____

Address: _____ Phone: _____
(Street) (Town/City) (State/Zip)

Type of Dwelling: (please check one of the following):

- | | |
|--|--|
| <input type="checkbox"/> One Family Residence | <input type="checkbox"/> Office Building |
| <input type="checkbox"/> Two Family Residence | <input type="checkbox"/> Store |
| <input type="checkbox"/> Condominium | <input type="checkbox"/> Industrial |
| <input type="checkbox"/> Other (Describe): _____ | <input type="checkbox"/> Fire Service |

Size of Water Service: 1" 1 1/2" 2" Other: _____

Variance Required: *YES NO *If yes, provide a copy of the Variance issued by the Municipal Entity

Swimming Pool: YES NO Underground Sprinkler System: YES NO

➤ **PLEASE NOTE THAT WHEN SUBMITTING THIS APPLICATION, A \$200.00 PROCESSING FEE MUST ACCOMPANY IT.**

This Application cannot be accepted if all information has not been completed.

I, _____, certify that I am the owner of the premises at
_____ located in Section: _____ Lot: _____ Block: _____

and I hereby apply for a supply of water for said premises. I agree that the water to serve said premises shall be used in conformity with the Ordinance Rules and Regulations of the Port Washington Water District, copies of which I have read and understood. I agree to pay for water service at the rate specified by the Board of Commissioners of the Port Washington Water District.

Date Application Completed: _____

Date Application Received: _____

Engineer/Architect's Address: _____

 _____

Property Owner's Signature

 (____) _____

Owner's Phone Number

Please PRINT Name

APPROVED

***DENIED**

* Reason for Denial: _____

 _____

Superintendent

Date

CUSTOMER INFORMATION:

- A single family residential dwelling allowance is up to 110,000 gallons per year (14,706 cubic feet).
- A two family residential dwelling allowance is up to 130,000 gallons per year (17,380 cubic feet).
- Commercial / Industrial accounts will be reviewed on an individual basis.

The following information must accompany this application:

1. Please submit a letter to the Commissioners of the Port Washington Water District describing the project.
2. A copy of the property survey, prepared by a licensed surveyor showing all pertinent information, new Section, Block and Lot(s).
3. * “Application for Approval of a Backflow Prevention Device” must be completed (form DOH-347).

NOTE: After building plans are reviewed by the District four copies of the completed DOH-347 form and approved Double Check Valve installation plan drawing along with the appropriate fee must be sent to the Nassau County Department of Health for review and final approval.

*****Commercial applications must submit Licensed Engineer / Registered Architect drawings for the installation of the RPZ. NOTE: Double Check Valve Plan Drawing MUST be on 8½x14 (legal size) paper.**

4. A full copy of the Building Plans showing the building dimensions, number of bedrooms, number of bathrooms, plumbing, floor space, slope of property, and the location of proposed water, sewer lines and any drainage pools.

* NOTE: After installing a Backflow Prevention Device, a completed NYS Dept of Health form DOH-1013 - “Report on Test and Maintenance of Backflow Prevention Device” must be completed by a Certified Backflow Prevention Device Tester. This must be forwarded to our Board of Commissioners or the Port Washington Water District within thirty (30) days of the installation of the device.

* ONLY ONE INCH (1”) SERVICE LINES AND PIT ASSEMBLIES CAN BE INSTALLED AT A NEW RESIDENTIAL DWELLING OR REMODELING WHICH REQUIRES A NEW SERVICE .

FIRE SYSTEM REQUIREMENTS:

If a fire sprinkler system is going to be present, a copy of the site plans/architect drawings must be submitted along with this application showing the following: hydrants, proposed sprinkler system, sprinkler heads, fire pump, location of detecto check valve arrangement, proposed location of connection to the Port Washington Water system, with the approval stamp of the Nassau County Fire Marshall, which must be filed with the District for approval of the fire service.

- a) Gallons per minute required: _____(gpm)
- b) Dry System: Yes No
- c) Water Filled System: Yes No
- d) Additives used for Freeze Protection: Yes No

A COPY OF THIS APPLICATION MUST GO TO THE BUILDING DEPARTMENT AFTER APPROVAL BY THE DISTRICT

The Port Washington Water District will furnish and install a new service line tap in the water main. The owner or the licensed plumber will pay all fees required under this application; furnish all material, including copper piping, curb stop, curb box and rod, meter and backflow device assembly - all in accordance with the Port Washington Water District standard specifications. The owner or licensed plumber must also make all excavations, backfill, and compaction of backfill; obtain all roadway opening permits; restore all surfaces disturbed during performance of the work; test, flush and disinfect the new water service installation and place in continuous satisfactory service.

Application for Approval of Backflow Prevention Devices

PRINT OR TYPE ALL ENTRIES EXCEPT SIGNATURES
Please completed items 1 through 12a + Block and Lot Numbers

Block #	Lot #	FOR DEPARTMENT USE ONLY Log No.
---------	-------	------------------------------------

1. Name of Facility	2. City, Village, Town	3. County
4. Location of Facility <small>Street</small>	City	state zip
4a. Phone Numbers	5. Contact Person	
5. Approx. Location of Device(s)	6. Mfg. Model #	Size of Device(s)

# of Fire Services	# of Domestic Services	# of Combined Services	Total # of Services	Total # of Buildings
--------------------	------------------------	------------------------	---------------------	----------------------

7. Name of Owner	Title	Phone Number	8. Nature of works <input type="checkbox"/> Initial Device Installation <input type="checkbox"/> Replace Existing Device
Full Mailing Address <small>street</small> Address _____ City _____ state _____ zip _____			8a. <input type="checkbox"/> New Service <input type="checkbox"/> Existing Service
Owner's Signature _____ Date M / D / Y			8b. <input type="checkbox"/> New Building <input type="checkbox"/> Existing Building <input type="checkbox"/> Major Renovations

9. Name of Design Engineer or Architect	10. NYS License #
<p>NCDH approved typical plan is being used</p> <p><small>Original Ink signature and seal required on all copies</small></p>	<p>_____</p> <input type="checkbox"/> PE <input type="checkbox"/> RA <input type="checkbox"/> Other
	10a. Telephone Number(s)
	Date M / D / Y

11. Water System Pressure (psi) at Point of Connection Max _____ Avg _____ Min _____	12. Estimate Installation Cost	12a. Estimate Design Cost
---	--------------------------------	---------------------------

13. Degree of Hazard <input type="checkbox"/> Hazardous <input type="checkbox"/> Aesthetically Objectionable	List of processes or reasons that lead to degree of hazard checked: _____ _____
--	---

14. Public water supply name Port Washington Water District Mailing Address 38 Sandy Hollow Road <small>street</small> Port Washington NY 11050 <small>City state zip</small> Telephone No. (516)767-0171	Name of supplier's designate representative Title Paul Prignano, Superintendent Signature _____ M / D / Y
---	--

Note: All applicants must be accompanied by plans, specifications and an engineer's report describing the project in detail. The project must first be submitted to the water supplier, who will forward it to the local public health engineer. This form must be prepared in quadruplicate with four copies of all plans, specifications and descriptive literature.

BRUCE A. BLAKEMAN
NASSAU COUNTY EXECUTIVE



NASSAU COUNTY DEPARTMENT OF HEALTH

Cross-Connection Control Plan Review Fees

Fee Schedule
(Effective August 1, 2012)

<u>Project Type</u>	<u>Fee Amount</u>
Double Check Valve (Residential)	- \$140 per device
Double Check Valve (Non-Residential)	- \$275 per device
¾ to 2” Reduced Pressure Zone Device	- \$275 per device
Greater than 2” Reduced Pressure Zone Device	- \$485 per device
Expedited Review of Cross- Connection Control Plans	
Custom Plans	- \$250 additional


All plans received must be accompanied by a check made out to “Nassau County Department of Health” for the appropriate dollar amount.



2018 NACCHO LOCAL HEALTH DEPARTMENT OF THE YEAR
200 COUNTY SEAT DRIVE, MINEOLA, NEW YORK 11501
Phone: 516-227-9692 Fax: 516-227-9613




F:\269876\figures\2026-04-24\269876-Meter Pit Installation-Layout1.dwg, Layout1, 4/24/2026 11:13:05 AM, DBCadd

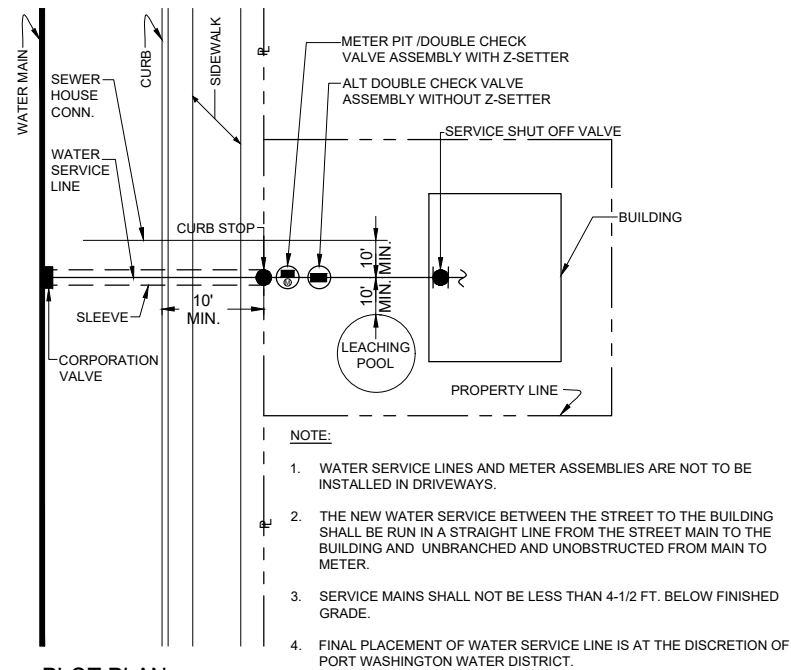


PLOT PLAN
SCALE: N.T.S.

- NOTE:**
1. WATER SERVICE LINES AND METER ASSEMBLIES ARE NOT TO BE INSTALLED IN DRIVEWAYS.
 2. THE NEW WATER SERVICE BETWEEN THE STREET TO THE BUILDING SHALL BE RUN IN A STRAIGHT LINE FROM THE STREET MAIN TO THE BUILDING AND UNBRANCHED AND UNOBSTRUCTED FROM MAIN TO METER.
 3. SERVICE MAINS SHALL NOT BE LESS THAN 4-1/2 FT. BELOW FINISHED GRADE.
 4. FINAL PLACEMENT OF WATER SERVICE LINE IS AT THE DISCRETION OF PORT WASHINGTON WATER DISTRICT.

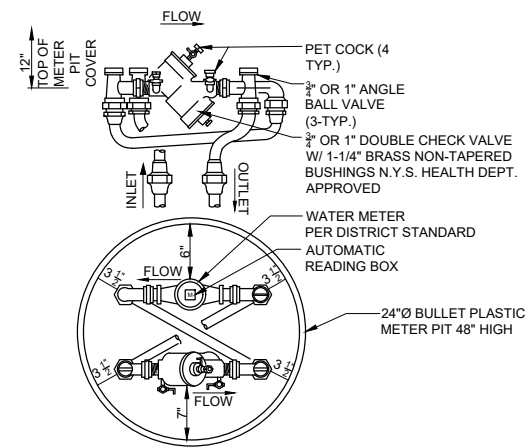

TYPICAL METER PIT INSTALLATION PLAN AND ELEVATION



SCALE: N.T.S.

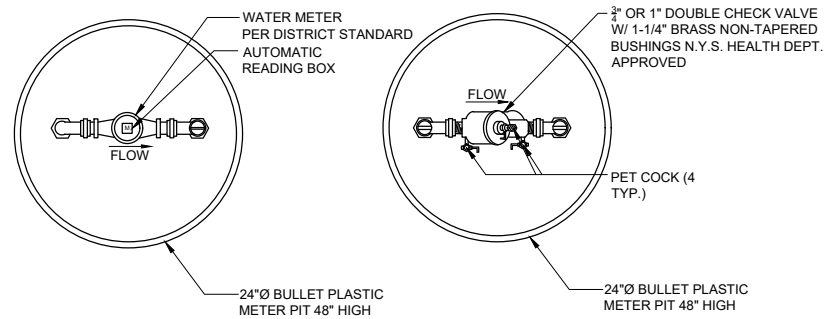

ALTERNATE TYPICAL METER PIT INSTALLATION PLAN AND ELEVATION




SCALE: N.T.S.

REQUIRED SEPARATION DISTANCES
RECOMMENDED STANDARDS FOR WATER WORKS
CLEARANCES BETWEEN WATER MAINS & SEWER & STORM DRAINS
NEW YORK STATE DEPARTMENT OF HEALTH

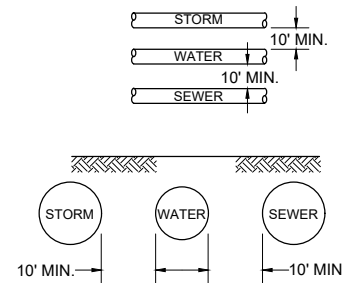


NOTE: LAYED IN SEPARATE TRENCH OR UNDISTURBED EARTH SHELF LOCATED ON ONE SIDE OF THE SEWER.

- a. SEWER TO BE CONSTRUCTED OF SLIP-ON OR MECHANICAL JOINT CAST IRON PIPE.
- b. PRESSURE TESTED TO ASSURE WATER TIGHTNESS BEFORE BACKFILLING.

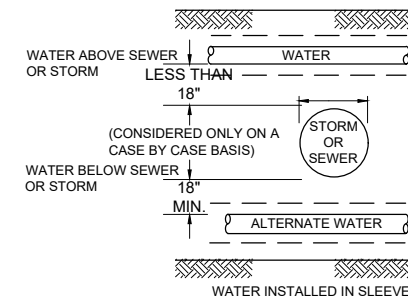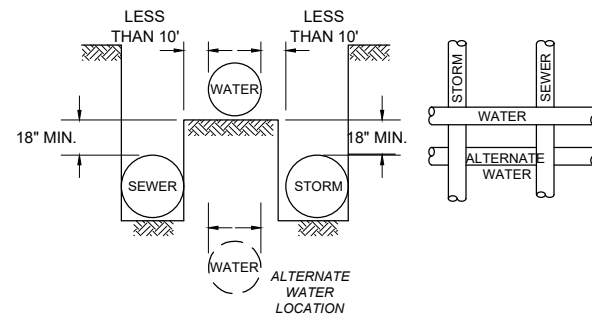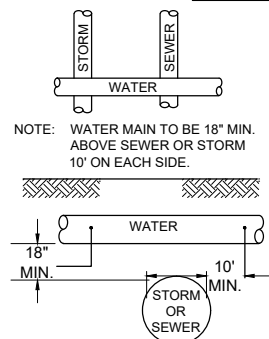

GENERAL NOTES:

1. INSTALLATION SHALL MEET ALL N.C.D.H. AND N.Y.S.D.O.H. REQUIREMENTS.
2. BACKFLOW DEVICE SHALL BE PROTECTED FROM FLOODING AND FREEZING AT ALL TIMES.
3. TOP OF WATER TIGHT PIT WITH DCV SHALL BE A MINIMUM OF 6-INCHES ABOVE GRADE AND GROUND AROUND IT SHALL SLOPE AWAY FOR POSITIVE DRAINAGE.
4. PIPING SHALL BE UNBRANCHED AND UNRESTRICTED FROM MAIN TO DEVICE EXCEPT FOR METER.
5. AN INITIAL TEST OF THE DEVICE SHALL BE PERFORMED BY A NYSDOH CERTIFIED TESTER PRIOR TO THE DEVICE BEING PLACED INTO SERVICE. NYSDOH FORM # DOH-1013 (REPORT ON TEST AND MAINTENANCE OF BACKFLOW PREVENTION DEVICE) SHALL BE COMPLETED IN ITS ENTIRETY AND ALL SATISFACTORY TEST RESULTS SHALL BE FORWARDED TO PORT WASHINGTON WATER DISTRICT AND NASSAU COUNTY DEPARTMENT OF HEALTH.
6. IT IS THE PROPERTY OWNER'S RESPONSIBILITY FOR THE BACKFLOW PREVENTION DEVICE TO BE TESTED AND INSPECTED AT LEAST ANNUALLY BY A NYSDOH CERTIFIED BACKFLOW TESTER WITH RESULTS REPORTED TO PORT WASHINGTON WATER DISTRICT USING NYSDOH FORM # DOH-1013'.
7. DISCHARGE FROM BACKFLOW DEVICE TO BE POSITIVE WITH EFFLUENT VISIBLE WITH DISCHARGE ABOVE HIGHEST POSSIBLE FLOODING LEVEL.
8. ALL WATER SERVICE PIPING AND FITTINGS SHALL BE CERTIFIED "LEAD-FREE" MATERIALS.
9. THE PROPOSED BACKFLOW PREVENTION DEVICE SHALL BE LEAD FREE AND SHALL BE FROM A LIST OF APPROVED BACKFLOW PREVENTION DEVICES BY UNIVERSITY OF SOUTHERN CALIFORNIA (USC).
10. BACKFLOW DEVICE TO BE ONE SIZE LARGER WHERE PRESSURE IS LOW OR CRITICAL.
11. BACKFLOW DEVICE SHALL BE INSTALLED IMMEDIATELY AFTER THE METER, IF POSSIBLE. IF THE DEVICE IS NOT IN THE SAME LOCATION AS THE METER, OR IS EVER GREATER THAN 10-FEET FROM THE METER A NOTE STATING THAT ALL PIPING NOT PROTECTED BY BACKFLOW DEVICES SHALL BE STENCILED "FEED LINE TO RPZ/DCV DO NOT TAP" AT 5-FOOT INTERVALS.
12. METER PIT SHALL BE KEPT FREE OF SOIL AND DEBRIS.



PROPOSED BACKFLOW PREVENTION DEVICE

MANUFACTURER _____ MODEL _____

ADDRESS _____

ENDORSED BY THE PORT WASHINGTON WATER DISTRICT FOR INSTALLATION OF A _____ (SIZE) DOUBLE CHECK VALVE

BY _____ DATE: _____



NASSAU COUNTY MINIMUM PLAN NOTES AND COMMENTS

FOR BACKFLOW DEVICE INSTALLATION PLANS

Please complete the New York State DOH-347 Application for Approval of Backflow Prevention Devices and submit 4 copies of the application/plans with the water supplier's endorsement for approval.

I. Minimum notes required on plans

- _____ A. DCV/RPZ installation to meet all NCHD and NYSHD requirements.
- _____ B. Devices must not be subject to flooding or freezing.
- _____ C. Piping to be unbranched and unrestricted from main to device except for meter.
- _____ D. Devices must be tested at least annually by a NYSHD certified tester.
- _____ E. Drainage to be positive with effluent visible (RPZ only).

II. Clearances Required (Provide actual dimensions on plans)

- _____ A. 30" minimum from centerline of device to floor (ALL).
- _____ B. 30" minimum from device to any obstructions (ALL).
- _____ C. 8" minimum from edge of device to wall (ALL).
- _____ D. 18" minimum from relief spout to floor (RPZ only).
- _____ E. Building dimensions (ALL).
- _____ F. Room or pit dimensions - as applicable (ALL).

III. Comments

- _____ A. Device must be immediately after water meter.
- _____ B. P.E. or R.A. seal on plans.
- _____ C. State make, model # and size of device on plans.
- _____ D. Identify premises on plans.
- _____ E. Show two views of device - plan and section.
- _____ F. Show accurate testcock location.
- _____ G. Show grade on all plans.
- _____ H. Drainage details for RPZ must be shown. How will water be disposed of?

- _____ I. Provide site plan (Street, water main, service line, location of meter and device. All service lines must be shown with sizes).
- _____ J. Leave adequate space for NCDH approval stamp.
- _____ K. All material to be submitted in quadruplicate.

IV. Devices must be located directly after the water meter if possible. If the device is not located in the same location as the meter, or if there is no meter, a note stating that all piping not protected by the backflow device shall be stenciled "Feed Line To RPZ/DCV Do Not Tap" at 5 foot intervals.

PORT WASHINGTON WATER DISTRICT

38 Sandy Hollow Road, Port Washington, NY 11050 ♦ (516) 767-0171 ♦ (516) 767-1145 -Fax



Owner Authorization Form

To Whom It May Concern:

I (WE), _____

AS THE OWNER(S) OF THE PREMISES SITUATED AT:

_____ (STREET) _____ (City) _____ (ZIP CODE)

SECTION: _____ **BLOCK:** _____ **LOT:** _____

HAVE AUTHORIZED: _____

TO DO: _____

AT SAID PREMISES.

SIGNED: _____
(SIGNATURE)

ADDRESS

() _____
TELEPHONE NUMBER

DATE

PORT WASHINGTON WATER DISTRICT

Specifications & Regulations for Installation of New Service Mains and Replacement / Repair of Existing Service Mains

- The plumber must be licensed to work in the particular area (village, town).
- The plumber must be bonded in favor of the Port Washington Water District in the sum of \$10,000 (ten thousand dollars) and the bond must stipulate that the plumber shall comply with the rules and regulations of the District.
- An authorization slip from the property owner must be submitted to the District, giving permission for the plumber to do the work. This permission slip must be verified for accuracy by the District and must show the name of the owner, the address, section, block, and lot. This slip must be signed and dated.
- All new services, shall be required to have an approved Backflow Prevention Device. Applications for approval of all Backflow Prevention Devices shall be presented for approval by the District on New York State Department of Health's "Application for Approval of a Backflow Prevention Device", form DOH-347.
- All service lines (Commercial / Residential) shall be no less than 1 inch (1") in diameter and shall be installed in an outside meter pit.
- Final decision for the placement of proposed water service line and the size is at the discretion of the Port Washington Water District.
- For a new or replacement 1 inch (1") service, the copper tubing shall be laid in one continuous length between the main and the meter pit, and from the meter pit to the building. A coupling will be allowed only when the service line is over 100 feet (100'). No joints between these points shall be permitted.
- When the service line is replaced at a residence having an inside meter, the meter shall be reinstalled in an outside meter pit with an approved Backflow Prevention Device.
- No service line shall be installed in a driveway.
- All building construction on a slab, or on a grade with no basement, cellar or crawl space, wherein the water service extends more than four inches (4") inside the outside wall facing the street, the service shall be encased in a sleeve at least ½" larger than said service line, if necessary.
- Plumber must submit a copy of the Street Opening Permit to the Port Washington Water District in advance of the commencement of work.
- On new accounts – all meters, yokes, meter pits and meter covers, and backflow prevention devices shall be purchased from the Port Washington Water District. The materials for the service line installation will be delivered to the premises by the District at the time the tap is made.
- Customers may only purchase water meters from the District. Meters purchased from other vendors are not permitted.
- All materials to be used must meet the Port Washington Water District's standard specifications.
- All materials, labor charges, inspection fees, etc., must be paid for in advance of the start of work.
- Tapping shall be performed by the Port Washington Water District only. All other work shall be done by the plumber. No plumber or other party shall interfere with any service pipe or connection within the District without first notifying said District. No plumber shall be permitted to tap a water distribution main. Tapping shall not be done on Saturdays or holidays.
- Plumbers must give 48-hour notice when a tap or any other type of work is requested.
- No tap shall be made after 2:00p.m.
- All service lines between the street main and the building shall be inspected by the Port Washington Water District before the trench is closed. This trench shall be dug at a right angle from the street to the building, and run in a straight line from the street main to the building.
- Whenever it shall be found that any other than the approved water service lines have been installed, the water will be cut off and will not be restored until the proper service line is installed, approved, and all costs for damage are paid. No further permits will be issued to the violator until all of the violations have been corrected.
- No plumber shall commence work on any service line without first notifying the Port Washington Water District in advance.
- All service lines, when installed, shall not be less than four and one half feet (4 ½') below finished grade. In no case shall any service line and water main be laid in any sewer, gas, electric or drain trench, nor any cesspool or sewer line.
- The meter pit for a one inch (1") service shall be placed upon not less than three (3) bricks at the bottom to prevent settling. The meter pit cover shall be installed at finished grade and left at finishing grade when the grading is complete. It is the responsibility of the plumber to install the meter pit; to protect it during construction; and to leave it at finishing grade when the construction and grading are fully complete, before the installation is accepted by the Port Washington Water District.
- All new one inch (1") or larger copper water service lines shall be encased (sleeved) in at least ½" larger than said service line from the point where it is tapped onto the District water main (corporate cock) to the inside of the meter pit. The sleeve must be of polyvinyl chloride plastic (PVC) pipe. After testing, it shall be sealed at each end with duck seal to prevent dirt and debris from entering the sleeve.